

Report of Test on
Sound Absorption Test
on
Novawall™
1 Inch Eased Acoustical Panel Assembly
for
Direct Path of Virginia, Inc.

NOISE UNLIMITED, INC.

104 S. Bridge St., Somerville, N.J. 08876

29 May 1990

Checked	Approved
M. Estrella	R.D. McAdoo
<i>M. Estrella</i>	<i>R.D. McAdoo</i>
<i>11 June 90</i>	<i>11 June 90</i>

1.0 Introduction

The sound absorption coefficient of a surface in a specified frequency band is, aside from the effects of diffraction, the fraction of randomly incident sound energy absorbed or otherwise not reflected. The unit of measurement is sabin per square foot.

The noise reduction coefficient, NRC, is the average of the sound absorption coefficients at 250, 500, 1000, and 2000 Hz expressed to the nearest integral multiple of 0.05.

2.0 Applicable Standard

Measurements were made according to:

ASTM Designation: C 423-89, "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method."

Standard Mountings are defined in:

ASTM Designation: E 795-83, "Standard Practices for Mounting Test Specimens During Sound Absorption Test."

3.0 Test Specimen

The test specimen consisted of three (3) 48 inch wide by 96 inch long by 2-1/4 inch thick panels placed side by side in type A mounting forming a test specimen 96 inches wide and 144 inches long. The specimen was submitted for testing by Direct Path of Virginia, Inc. and was identified as NovawallTM 1 Inch Eased


Acoustical Panel Assembly. The weight of the panels was 433-1/2 lbs. The area used to calculate sound absorption coefficients was 96 sq.ft., the area of the face of the specimen. The construction of the specimen per Direct Path of Virginia, Inc. was as follows; 5/8 inch drywall (sheetrock) with 1 inch height extruded polymer frame system attached with staples around the perimeter of the side to be tested. A 1/2 inch plywood stiffener was attached behind the drywall layer to provide stability during shipping. Nominal three (3) pound density fiberglass fill, 1 inch in height was attached to the area within the polymer frame. A woolen fabric (Wool Broadcloth Solid by Maharam) was stretched over the entire assembly and secured in the locking channels of the polymer extrusions.

4.0 Test Results

The calculated values of the sound absorption of the specimen and sound absorption coefficients together with the calculated measurement uncertainty for each are Tabulated in Table 1 and shown graphically in Figure 1.

Table 1. Sound Absorption and Sound Absorption Coefficient vs. Frequency on Novawall™ 1 Inch Eased Acoustical Panel Assembly for Direct Path of Virginia, Inc.

Frequency (Hz)	Absorption (Sabin)	Coefficient (Sabin/ft ²)
100	8.6 ± 4.9	0.09 ± 0.05
125	9.1 ± 4.1	0.10 ± 0.04
160	17.7 ± 3.1	0.18 ± 0.03
200	24.8 ± 2.6	0.26 ± 0.03
250	43.0 ± 1.8	0.45 ± 0.02
315	54.1 ± 1.8	0.56 ± 0.02
400	68.9 ± 2.7	0.72 ± 0.03
500	83.9 ± 1.9	0.87 ± 0.02
630	93.3 ± 1.6	0.97 ± 0.02
800	97.7 ± 1.5	1.02 ± 0.02
1000	101.3 ± 1.4	1.05 ± 0.01
1250	102.2 ± 1.2	1.06 ± 0.01
1600	103.0 ± 1.2	1.07 ± 0.01
2000	103.5 ± 1.1	1.08 ± 0.01
2500	103.3 ± 1.0	1.08 ± 0.01
3150	103.7 ± 1.3	1.08 ± 0.01
4000	100.2 ± 1.1	1.04 ± 0.01
5000	99.9 ± 1.1	1.04 ± 0.01
Noise Reduction Coefficient, NRC 0.85		

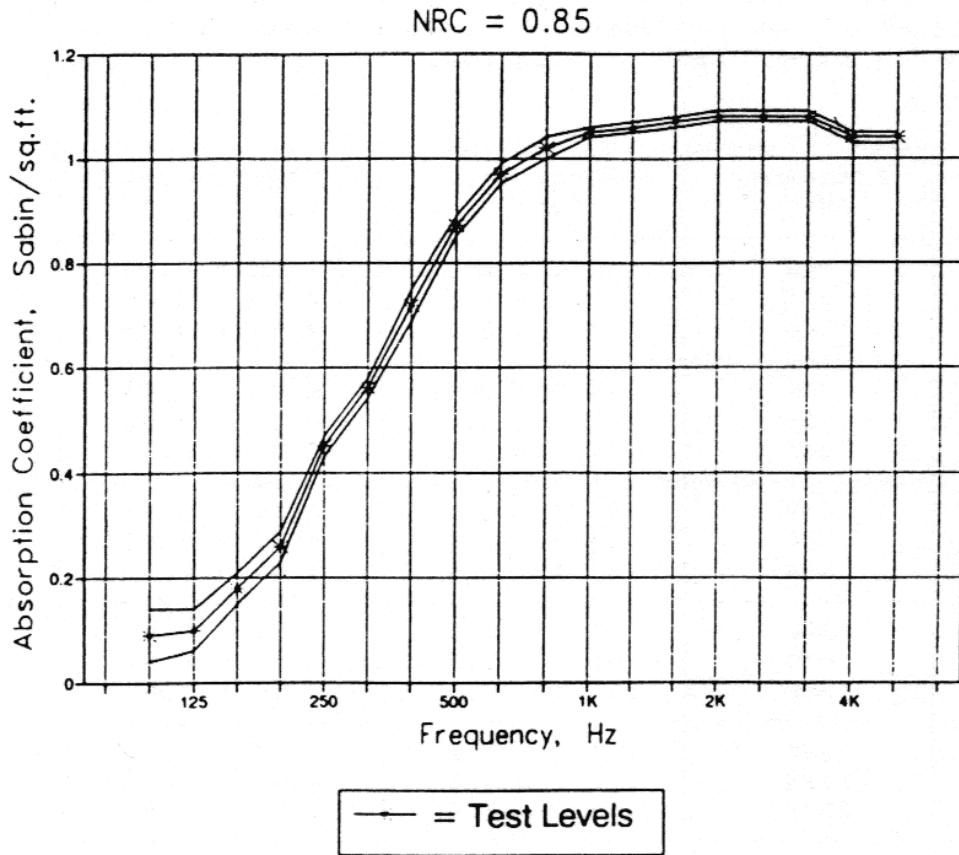

Sound Absorption Coefficient (Sab/ft²) vs. Frequency (Hz)
on NovawallTM 1 Inch Eased Acoustical Panel Assembly

Figure 1